

HermeticXL

Alumbrado de emergencia / Emergency lighting

Sede central / Headquarters
Normagrup Technology S.A.

Parque Tecnológico de Asturias, C/Ablanal nº 1,
33428 Llanera (Asturias). España / Spain
normagrup@normagrup.com
normagrup.com

Normagrup UK Black Country House, Rounds Green Road,

Oldbury, B69 2DG / **Normagrup Netherlands**

Korte Huifakkerstraat 18. 4815 PS Breda, The Netherlands /

Normagrup Portugal Rua da Imprensa N. 2D. 3200-149 Lousã

(Portugal) / **Normagrup Iluminación de México SA de CV**
Av. Ignacio Comonfort 239. Col. Sta Ana Tlalpaltitlán Toluca, Estado
de México. C.P.: 50160 México. Tel. 72.29.17.88.30




- Las luminarias deberán ser colocadas y conectadas por un profesional electricista en ausencia de red.
- No instalar sobre superficie conductora.
- Lámpara (LEDs) no reemplazables.
- Sustituir la luminaria cuando la fuente de luz alcance el final de su vida.
- Sustituir la batería cuando no satisfaga la autonomía.
- Desconectar la red eléctrica antes de realizar cualquier tipo de operación de mantenimiento.


Este aparato cumple con los requisitos adicionales para los locales de pública concurrencia en España

- The luminaries can only be fixed and connected by an electrician and only after making sure that the power supply is disconnected.
- Do not mount on a conductive surface.
- Non replaceable light source (LEDs).
- Replace the luminaire when the light source reaches its end of life.
- Replace battery when not satisfying the autonomy.
- Power supply must be disconnected before performing any kind of maintenance task.

This device complies with all the additional requirements to be installed in public buildings.

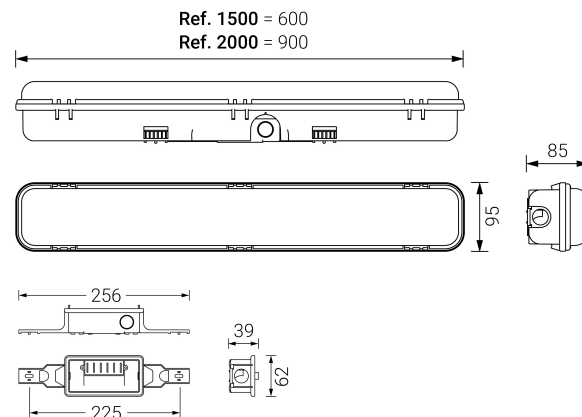

Instalación
Installation

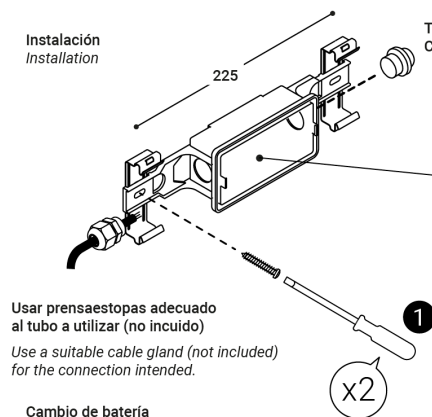

Usar prensaestopas adecuado al tubo a utilizar (no incluido)
Use a suitable cable gland (not included) for the connection intended.

Cambio de batería
Battery replacement

