

Via W

Alumbrado de emergencia / Emergency lighting

Sede central / Headquarters
Normagrup Technology S.A.

Parque Tecnológico de Asturias, C/Ablanal nº 1,
33428 Llanera (Asturias). España / Spain
normagrup@normagrup.com
normagrup.com

Normagrup UK Black Country House, Rounds Green Road,

Oldbury, B69 2DG / **Normagrup Netherlands**

Korte Huifakkerstraat 18. 4815 PS Breda, The Netherlands /


Normagrup Portugal Rua da Imprensa N. 2D. 3200-149 Louã

(Portugal) / **Normagrup Iluminación de México SA de CV**
Av. Ignacio Comonfort 239. Col. Sta Ana Tlapaltitlán Toluca, Estado
de México. C.P.: 50160 México. Tel. 72.29.17.88.30






- Las luminarias deberán ser colocadas y conectadas por un profesional electricista en ausencia de red.
- No instalar sobre superficie conductora.
- Lámpara (LEDs) no reemplazables.
- Sustituir la luminaria cuando la fuente de luz alcance el final de su vida.
- Sustituir la batería cuando no satisfaga la autonomía.
- Desconectar la red eléctrica antes de realizar cualquier tipo de operación de mantenimiento.

Este aparato cumple con los requisitos adicionales para los locales de pública concurrencia en España

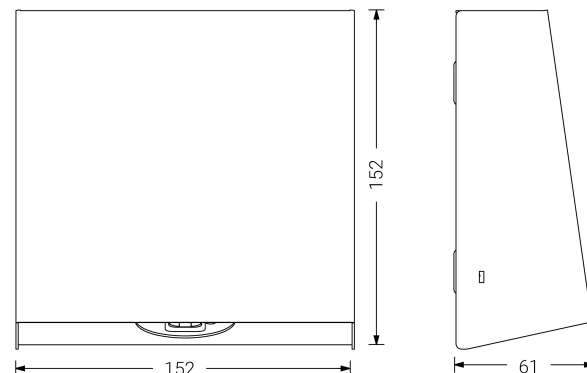

- The luminaries can only be fixed and connected by an electrician and only after making sure that the power supply is disconnected.
- Do not mount on a conductive surface.
- Non replaceable light source (LEDs).
- Replace the luminaire when the light source reaches its end of life.
- Replace battery when not satisfying the autonomy.
- Power supply must be disconnected before performing any kind of maintenance task.

This device complies with all the additional requirements to be installed in public buildings.

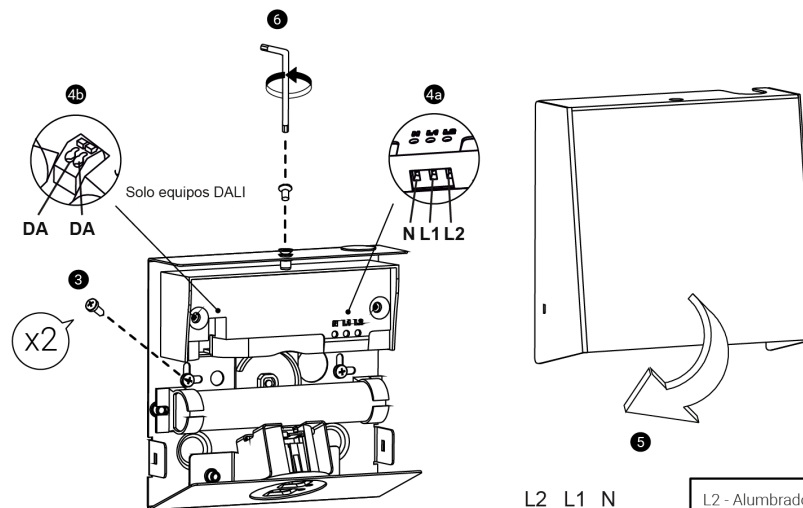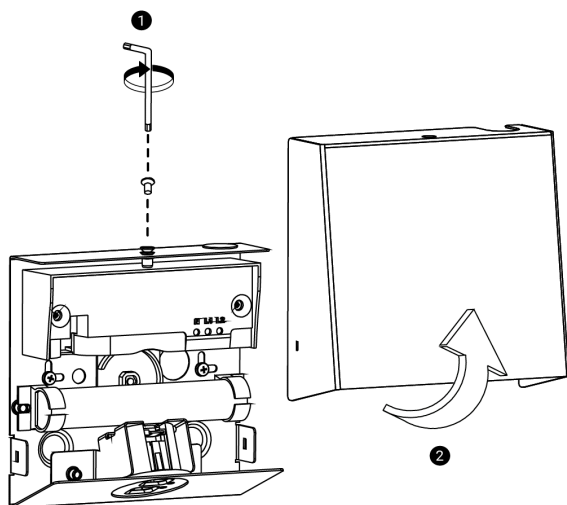

L2 - Alumbrado Ordinario
L2 - **Switched Line**
L1 - Línea Emergencia
L1 - **Permanent line**
N - Neutro
N - **Neutral**

Equipos 24V conexión sin polaridad
The 24V luminaires are polarity independent